

- BLOCK 1 LIFT LOBBY 2C
- ST-1 2C
- ST-2 2C
- ST-3 2C
- ST-4 2C
- ST-5 2C
- ST-6 { 2C
- 2C
- ST-8 2C
- ST-10 2C
- ST-11 2C
- ST-12 2C

2/F


1/F

COMMON FIRE ALARM
 MAIN POWER ON/FAILURE ALARM
 SPRINKLER WATER TANK H/L & L/L ALARM AT G/F
 F.S. WATER TANK H/L & L/L ALARM AT G/F
 SPRINKLER PUMP NORMAL/RUN/FAULT INDICATION AT G/F
 F.S. WATER PUMP NORMAL/RUN/FAULT INDICATION AT G/F
 GENSET RUN/FAULT INDICATION AT G/F

- ST-1 2C
- ST-4 { 2C
- 2C
- ST-10 { 2C
- 2C
- 2C
- ST-11 2C
- ST-13 2C
- ST-14 2C
- ST-15 { 2C
- 2C
- 2C
- ST-16 2C

G/F

LG/F

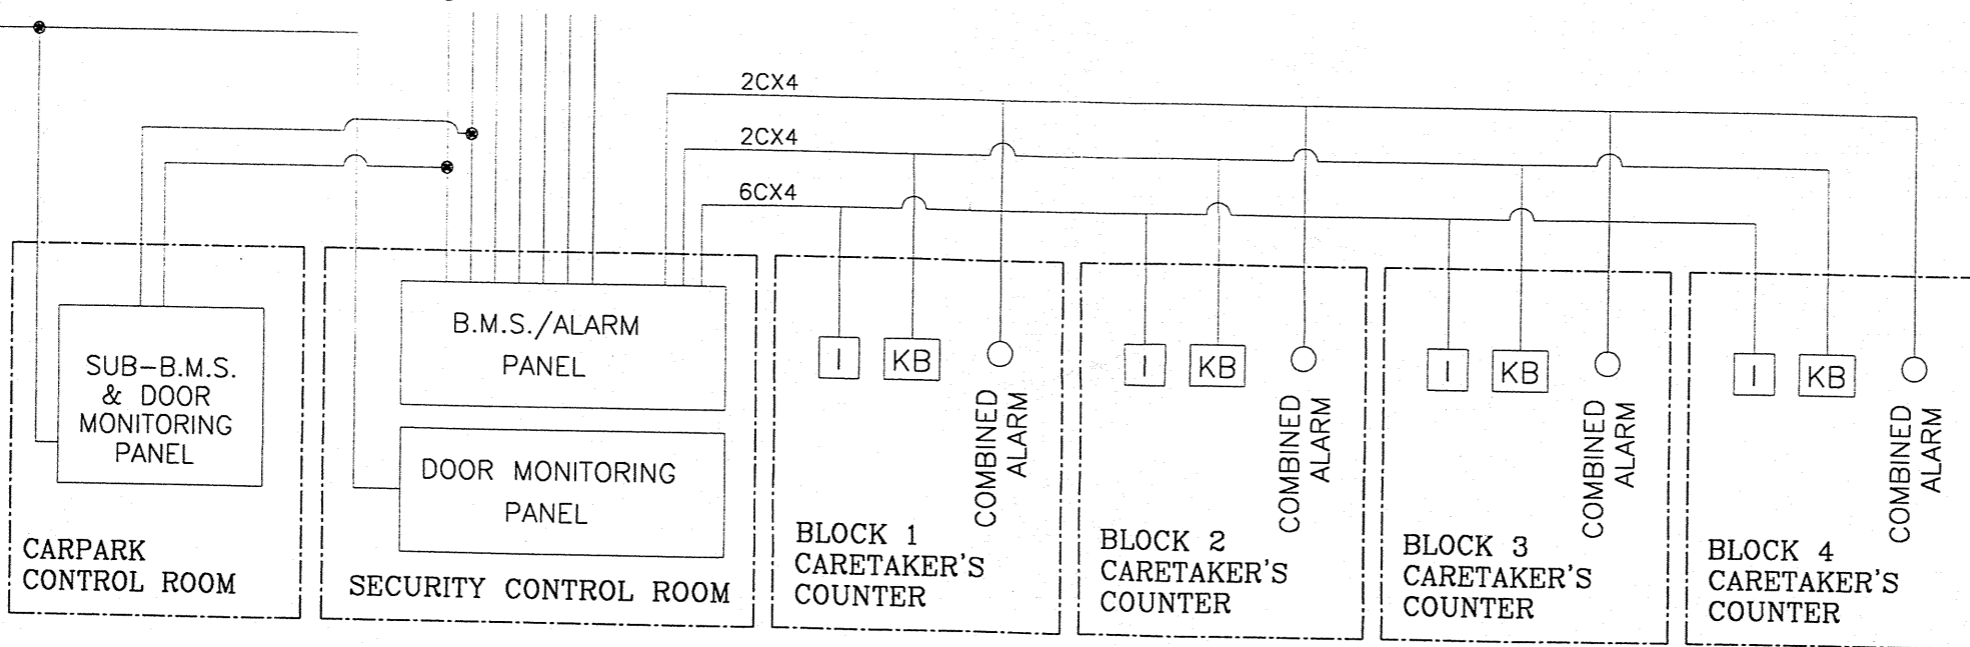

LEGEND:

- KB KICKBAR ALARM SWITCH
- I INTERCOM HANDSET
- MAGNETIC DOOR CONTACT

NOTE : ALL DOOR CONTACT CODE PLEASE REFER TO DOOR MONITORING PANEL DWG NO. 517-21

HKHS : PN
<small>ED / D(PM) / GM / AGM EMR / QMR APPROVED</small>
Reference No. : <small>PN - FD - 53200 - ELV - 517-11</small>
Revision No. : -
Approved by: <i>[Signature]</i>
Date : 1/6/2004

AS-FITTED

DATE	NO.	REVISION
PROJECT :		
TSEUNG KWAN O AREA 24		
TITLE :		
SCHEMATIC DIAGRAM OF B.M.S./ALARM SYSTEM		
TRIDANT ENGINEERING CO.,LTD <small>403, NEW WORLD CENTRE, 20, SALISBURY ROAD, TSMHATSUI, KOWLOON, HONG KONG TEL: 7334188</small>		
DATE :	10-9-97	SCALE : N.T.S.
DRAWN BY :	GARY LEUNG	CHECKED BY : S.Y.LAU
DRAWING NO.:	J3200-ELV-517-11	
		REV.